

PRELIMINARY
NOT FOR CONSTRUCTION

REFERENCE ITEMS		REV	DESCRIPTION	DATE	DES	CHK	APP
		A	ISSUE FOR REVIEW	04/17/2019	PRG	KGM	CS
		B	RE-ISSUE FOR REVIEW	06/20/2019	KGM	PRG	CS



124 Grove Street
Franklin MA, 02038

PROJECT NO: 327851

PRG
DESIGNED
AMW
DRAWN
KGM
CHECKED
CS
APPROVED

PRELIMINARY
TYPICAL NATIONAL GRID TRANSMISSION TYPE (H2.ST.D3) STR.
EAST POINT ENERGY CENTER
EAST POINT ENERGY CENTER, LLC
SCHOHARIE CO., NY


REVIEW 1
REVIEW 2


04/17/2019
DATE
AS NOTED
SCALE



T-001

REV.
A

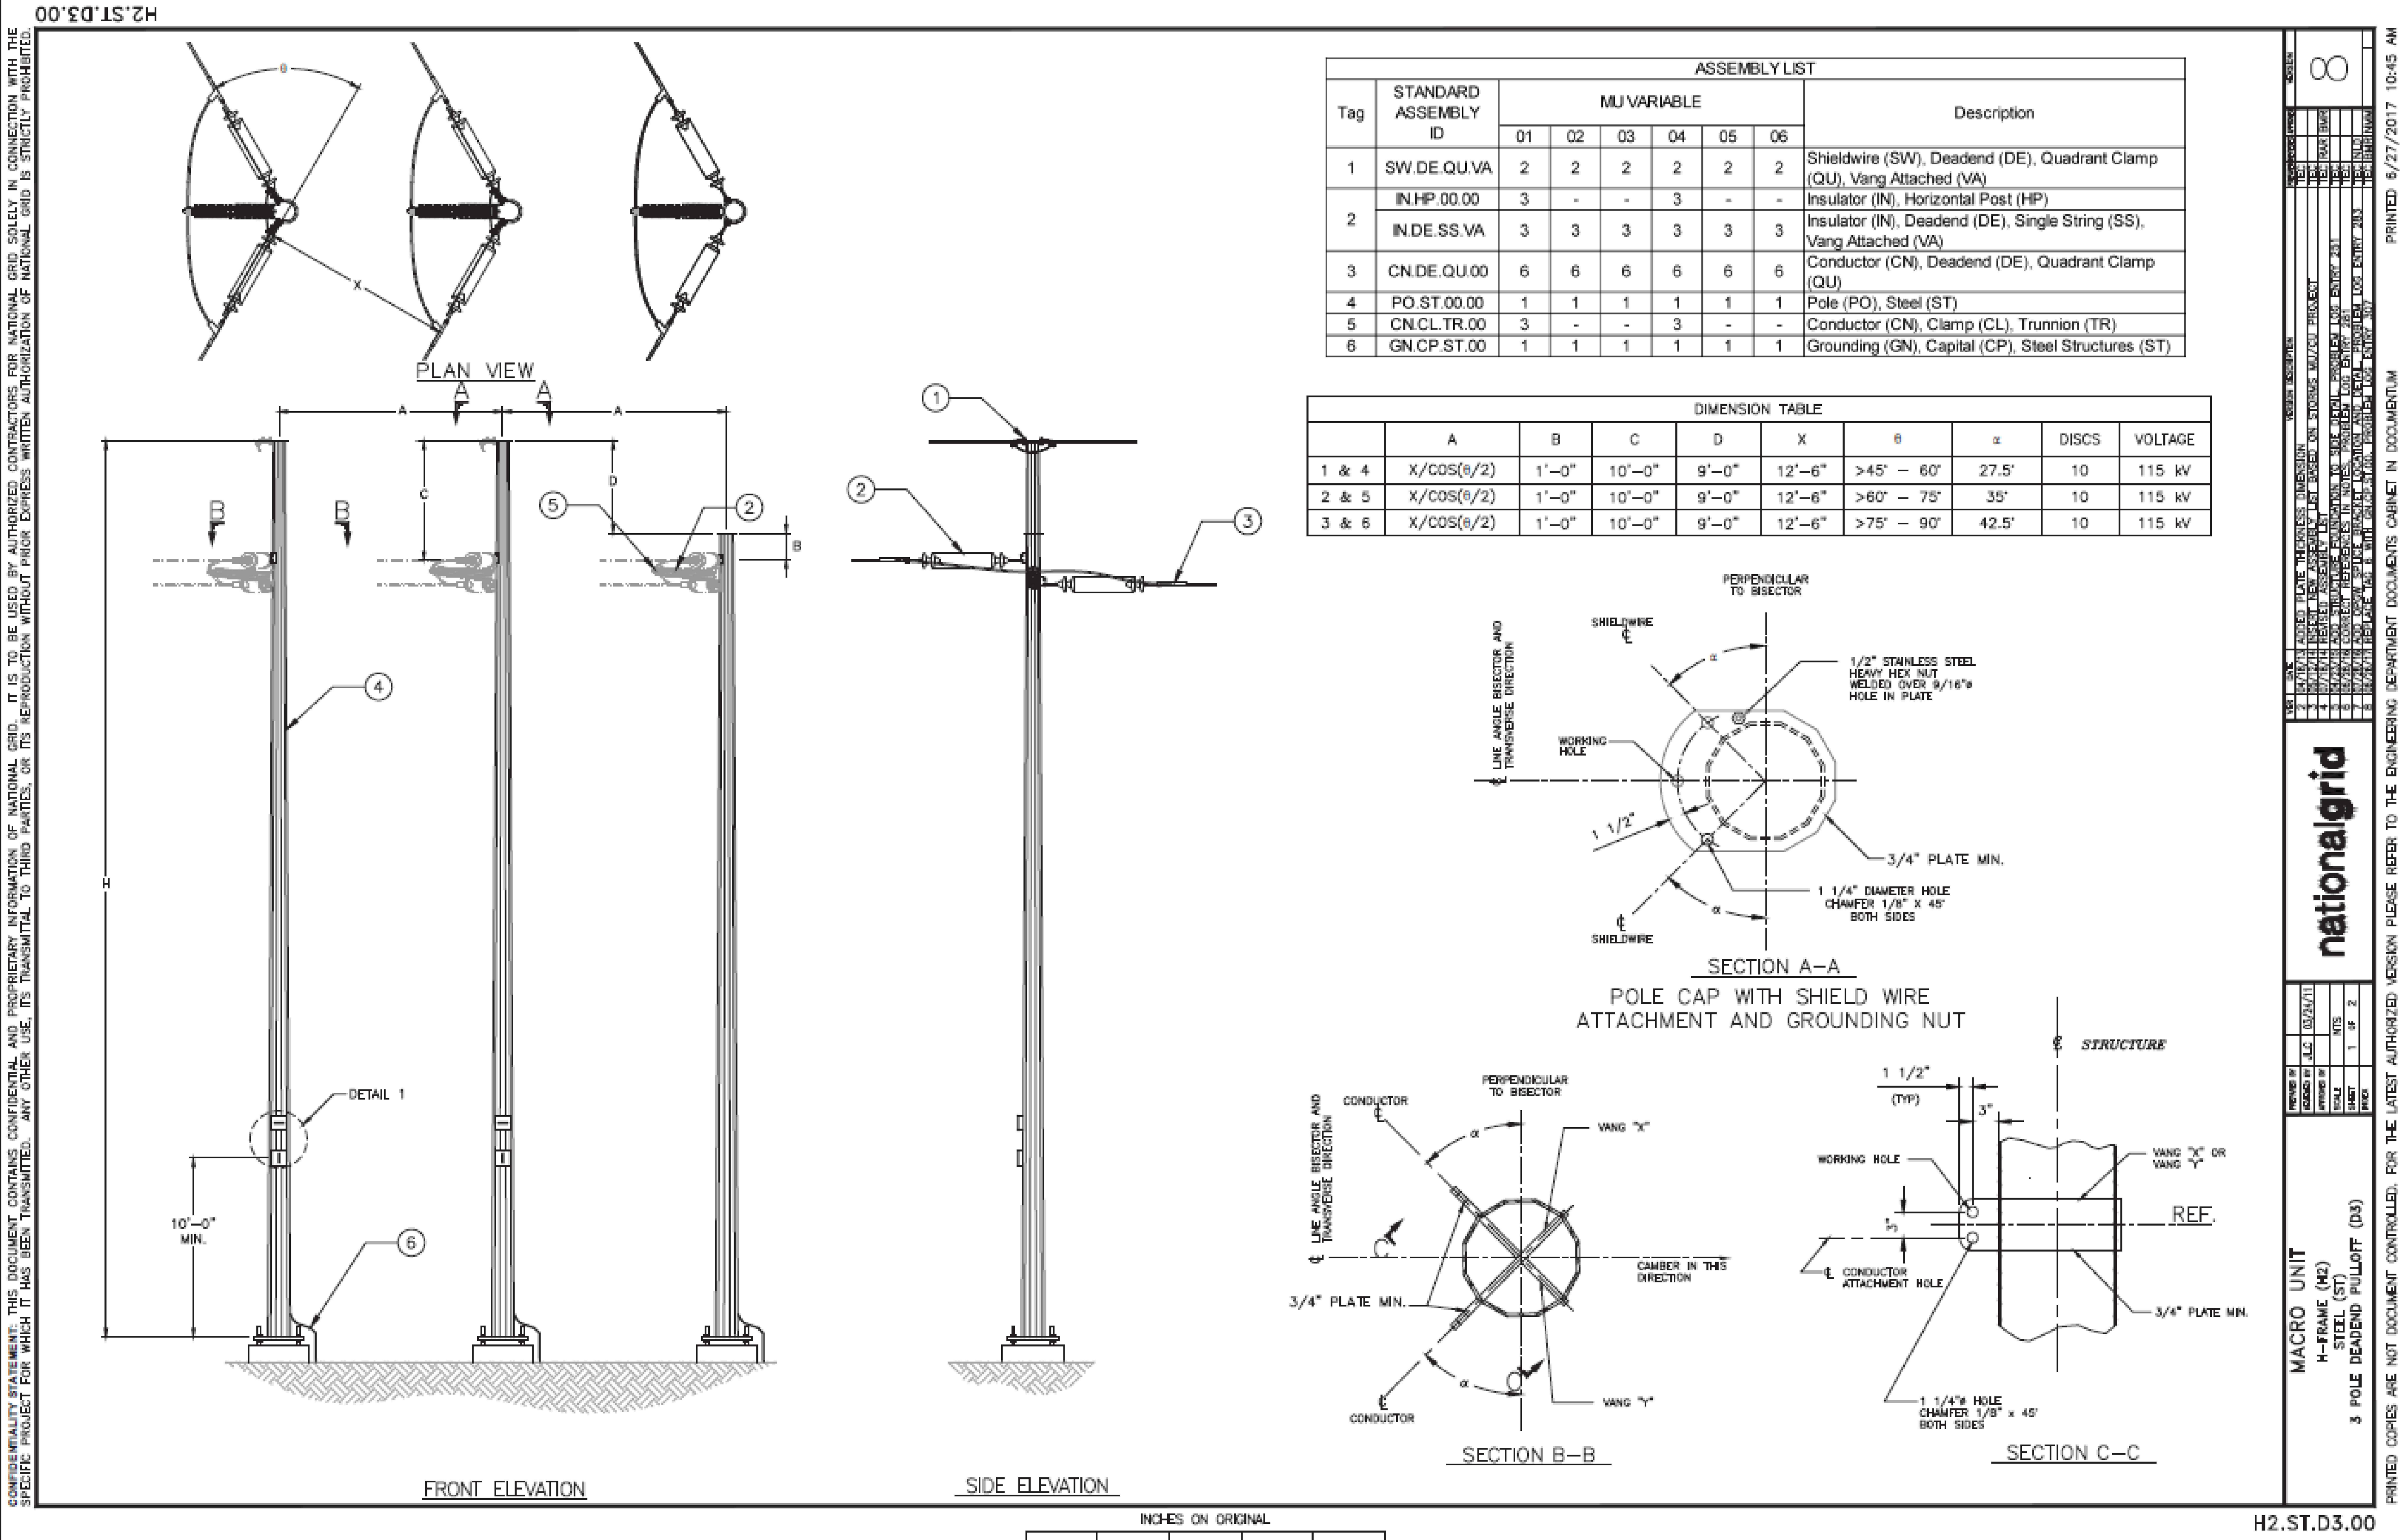


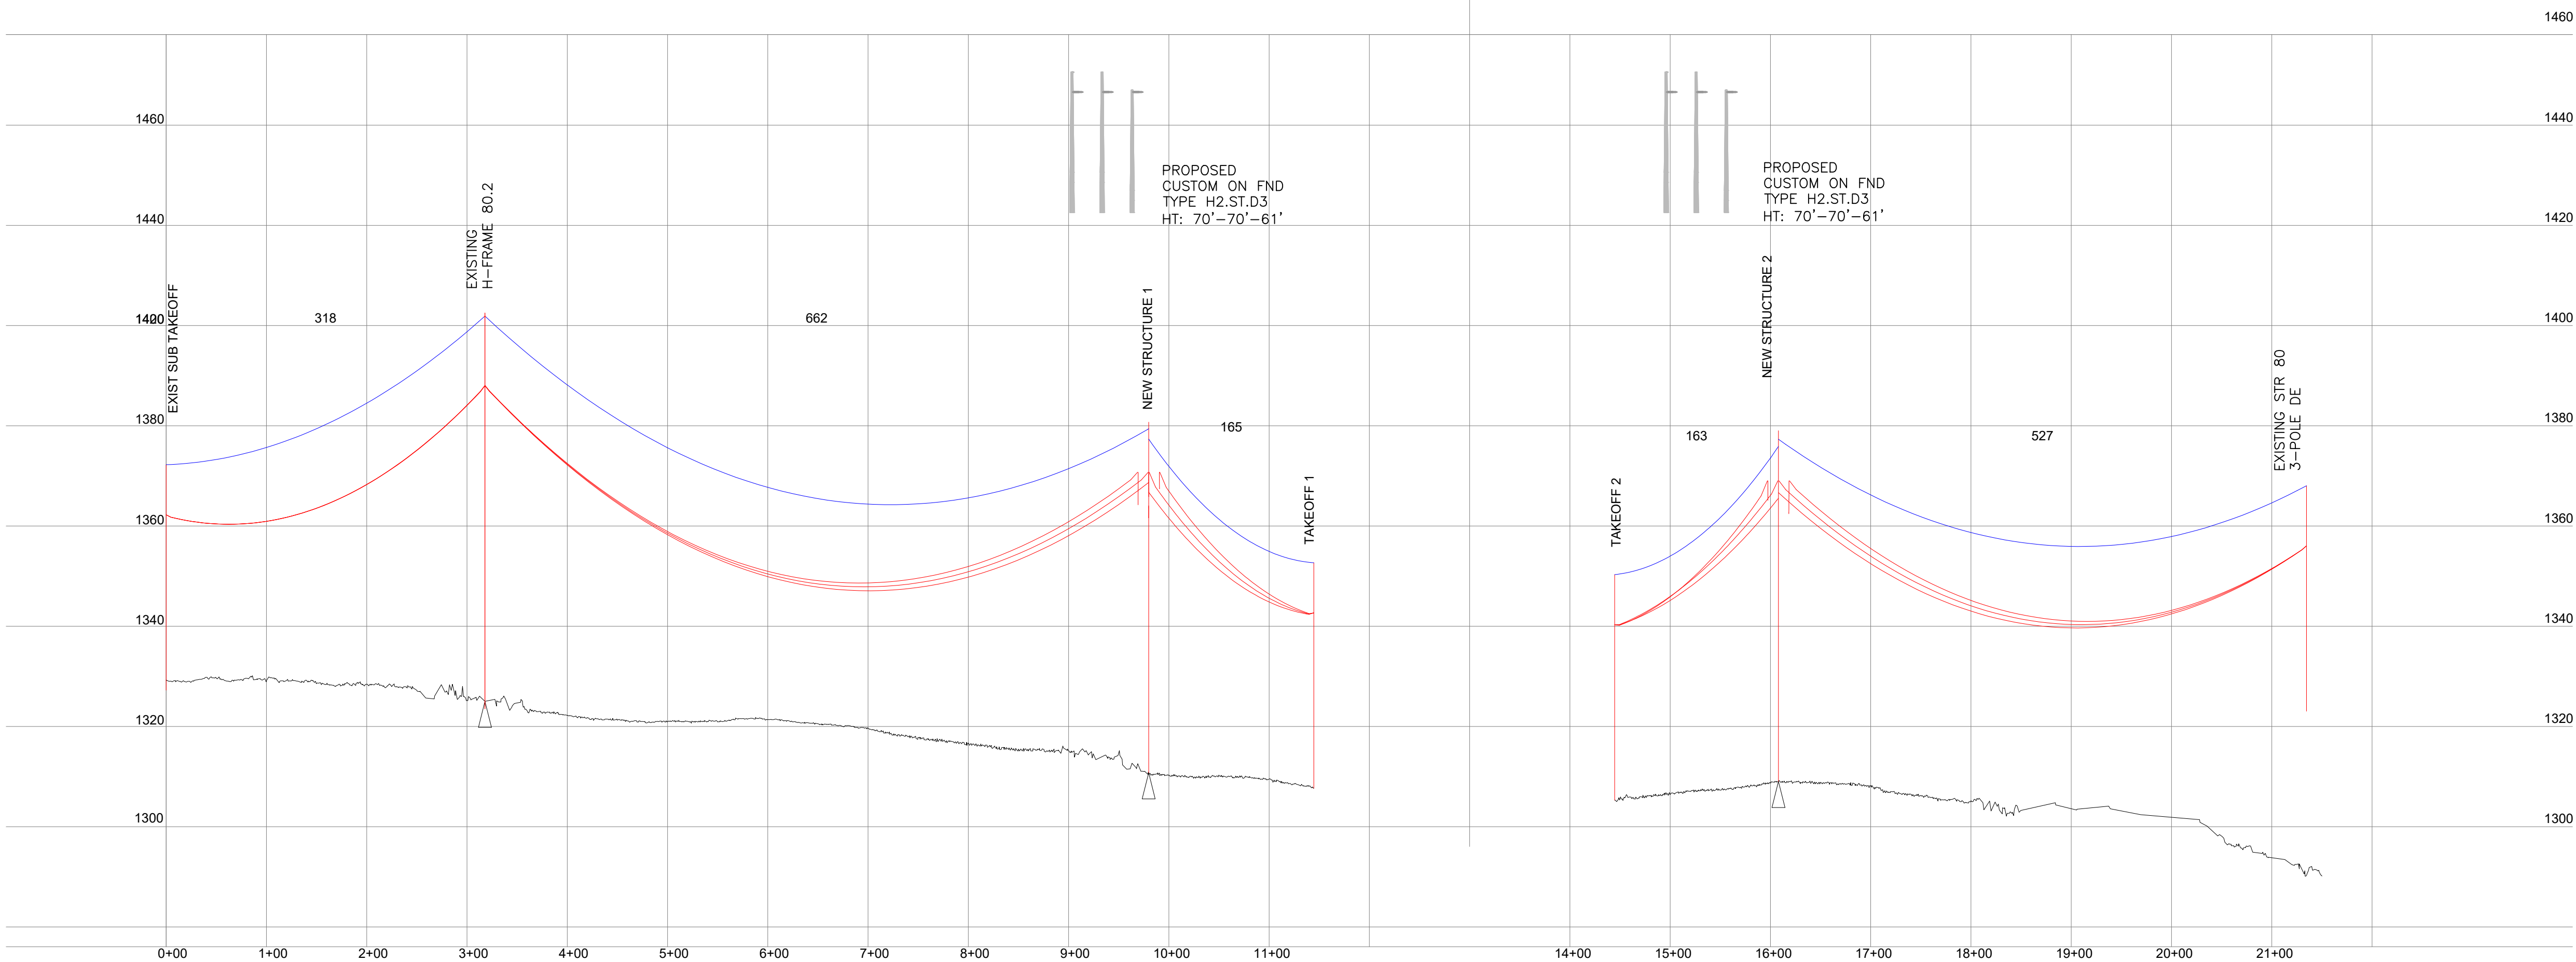

CONDUCTORS
-EXISTING STRUCTURES TO NEW 3-POLE STRUCTURES:
795 ACSR 3/8" "COOT" @ 6000# MAX TENSION
-NEW 3-POLE STRUCTURES TO NEW STATION TAKEOFF STRUCTURES:
795 ACSR 3/8" "COOT" @2000# MAX TENSION

SHIELDWIRE
-EXISTING STRUCTURES TO NEW 3-POLE STRUCTURES:
3/8" 7-STRAND EHS @ 3000# MAX TENSION
-NEW 3-POLE STRUCTURES TO NEW STATION TAKEOFF STRUCTURES:
3/8" 7-STRAND EHS @ 1000# MAX TENSION

UNDER NEW YORK STATE EDUCATION LAW ARTICLE 145 (ENGINEERING), SECTION 7209 (2), IT IS A VIOLATION OF THE LAW FOR ANY PERSON, UNLESS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

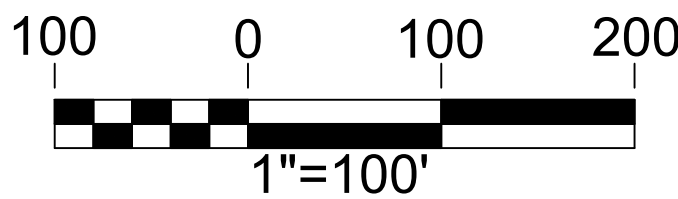

PRELIMINARY
NOT FOR CONSTRUCTION



REFERENCE ITEMS	



124 Grove Street

Franklin MA, 02038

PROJECT NO: 327851

REV	DESCRIPTION	DATE	DES	CHK	APP
A	ISSUE FOR REVIEW	04/17/19	PRG	KGM	CS
B	RE-ISSUE FOR REVIEW	06/20/19	KGM	PRG	CS
C	RE-ISSUE FOR REVIEW	08/22/19	KGM	PRG	CS

PRG DESIGNED		AMW DRAWN		KGM CHECKED		CS APPROVED	
REVIEW 1		04/17/19 DATE		AS NOTED SCALE		TRC	
REVIEW 2							

PRELIMINARY PLAN & PROFILE DRAWING EAST POINT ENERGY CENTER EAST POINT ENERGY CENTER, LLC SHARON SCHOHARIE CO., NY		T-002	REV. A
---	--	-------	-----------